


DH-200P

1

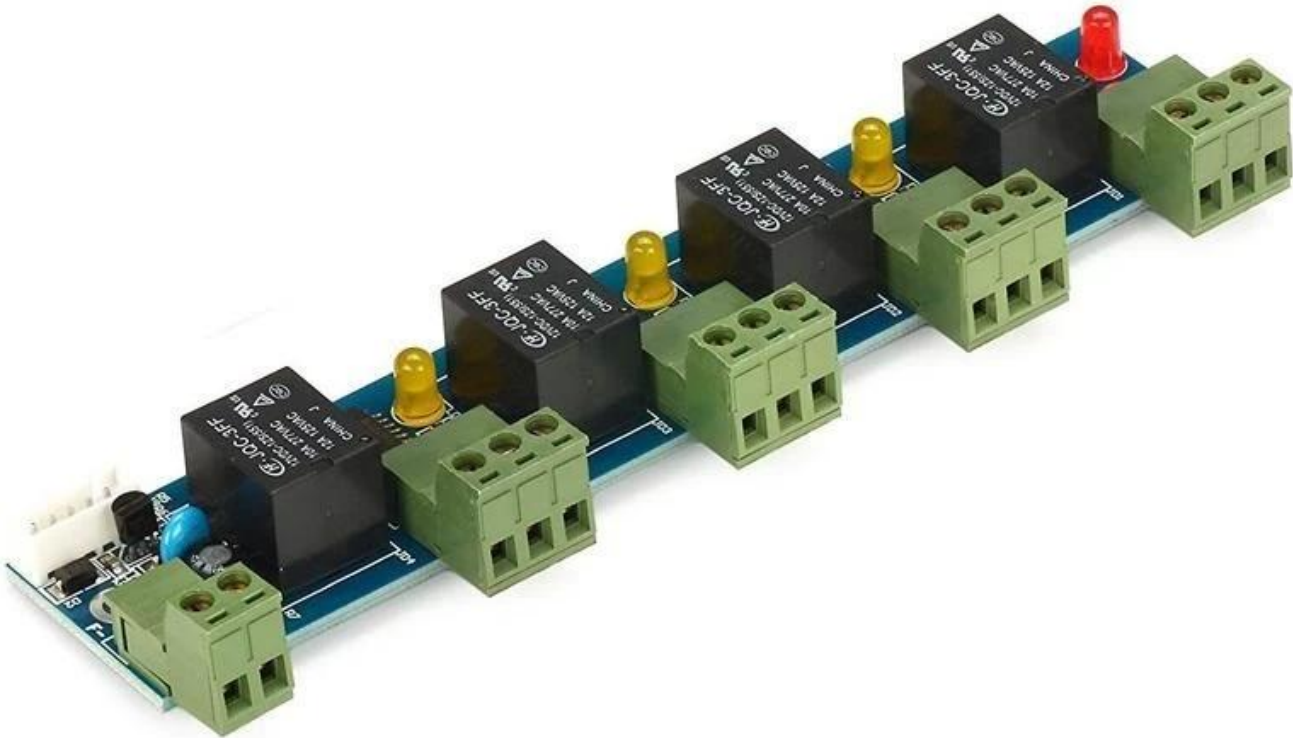


4


ii theFire



iii

iv06000

In the Box


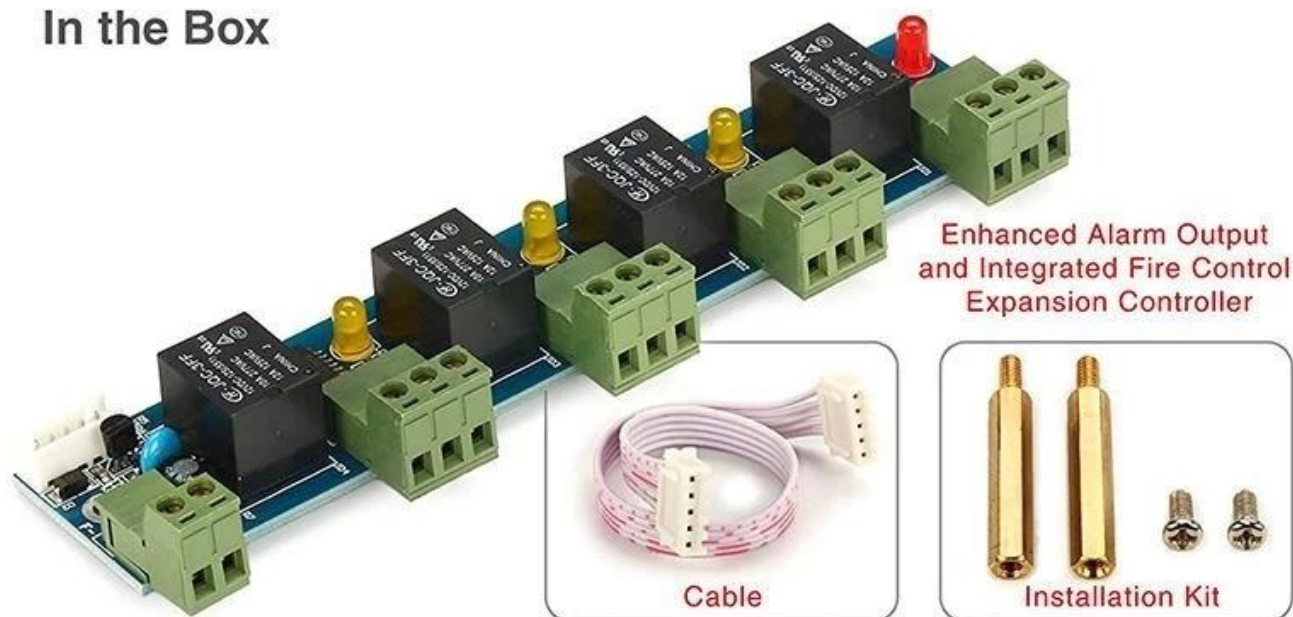


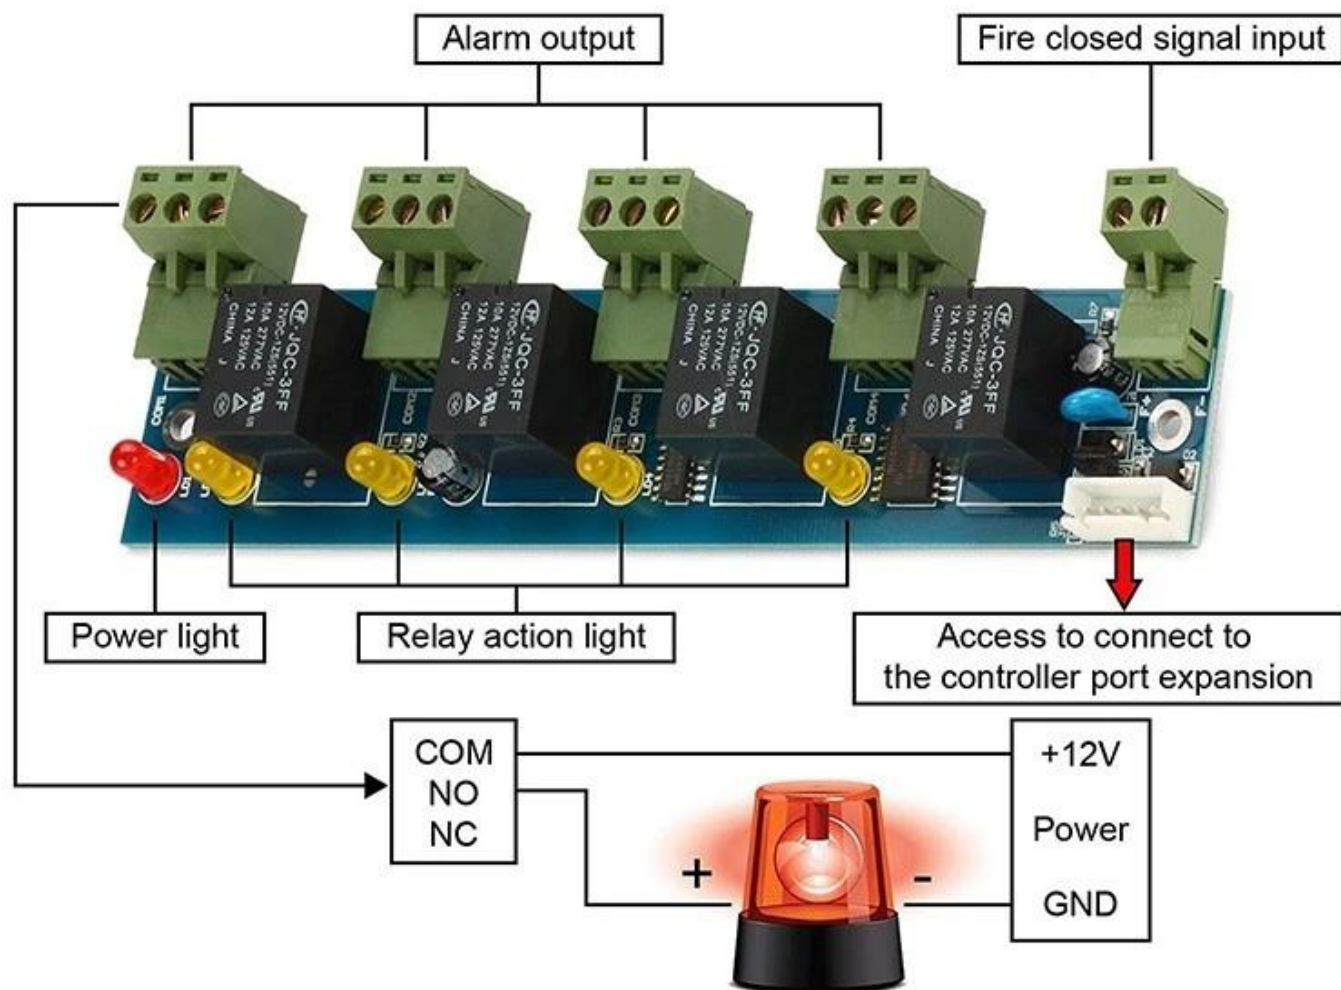

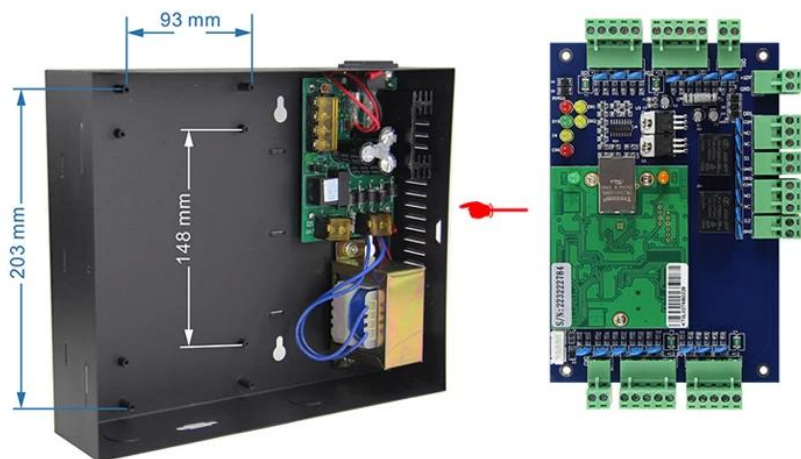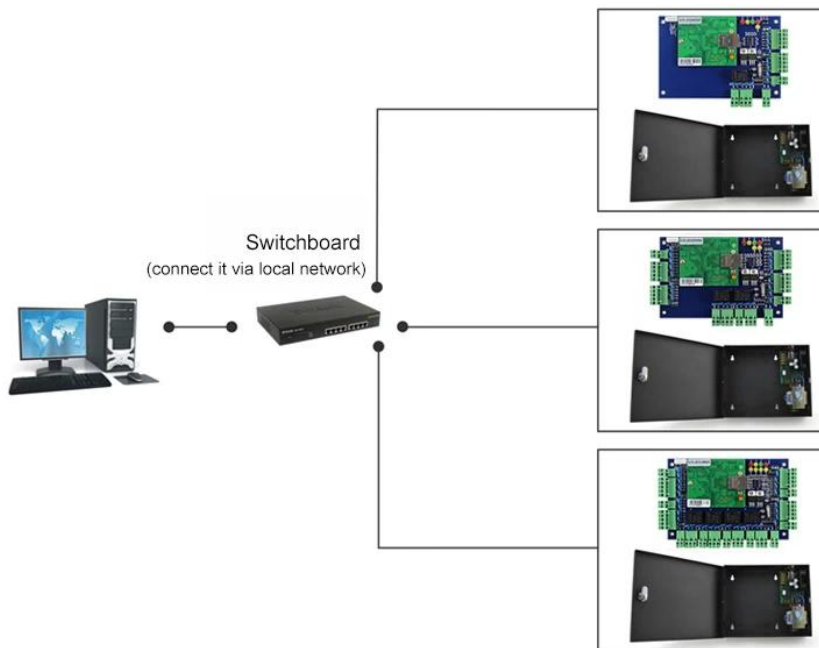

Kindly remind:

All network control board must configure with access power supply.
1 board for 1 power supply

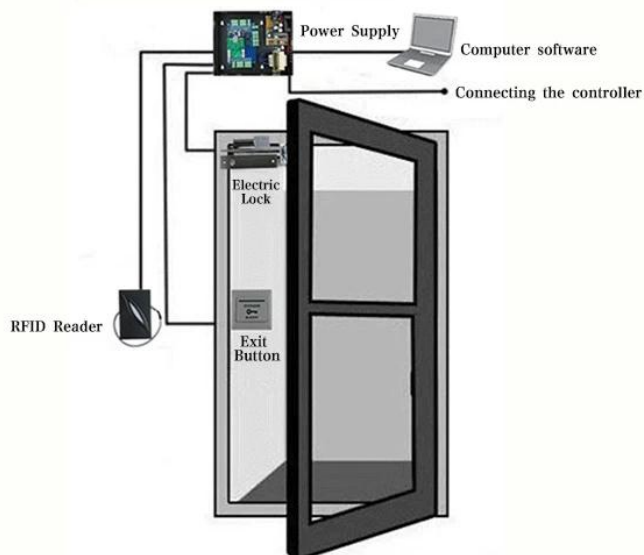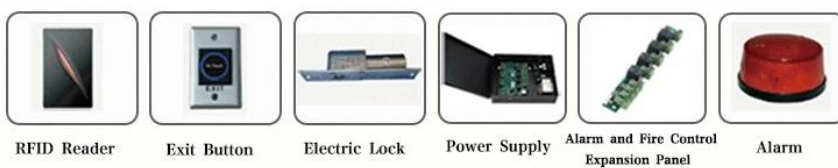

	DH-7001 DH-7002 DH-7004
	ACB V6.6
	1 4 5
	0-6000 0 6000